



## **CLAMP ON POWER LOGGER** PW3360-20

Power Measuring Instruments



# Handy and Easy to Use

-Power Management Support



#### **Reliable measurements start with** proper wiring.

#### The OUICK SET function guides you in

making the right connections.










#### ■ Supports single to three-phase, 4-wire circuits


- Simultaneously measure up to three single-phase, 2-wire circuits (in the same power system).
- Measure up to 780V with a 1000V display range
- Broadly applicable for many jobs, including leakage current measurement
  - An optional clamp-on leakage sensor supports measurements as low as 50 mA.
- Store months of data on SD cards



### Begin with QUICK SET Convenience

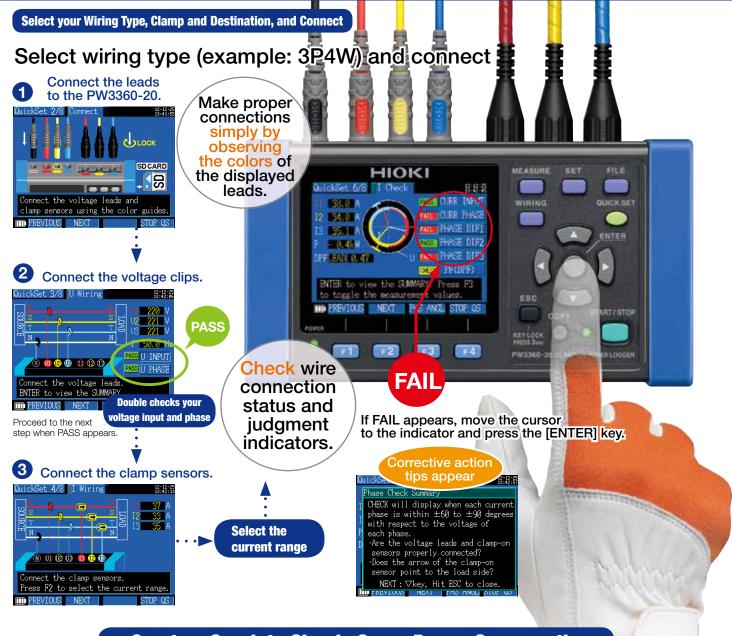

#### **Create a Graph to Clearly Grasp Power Consumption**

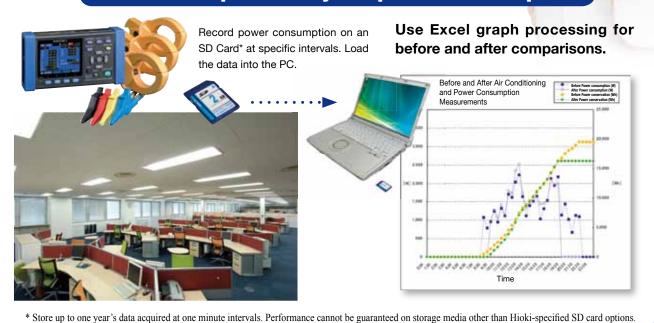

#### **Suits a Variety of Worksites**

#### ■ Where no AC power is available

Battery\* power provides about eight hours of continuous operation. In addition, a Voltage Line Power Adapter\* is available to power the PW3360-20 from the measurement lines.

\* Battery Set PW9002 and Voltage Line Power Adapter PW9003 options are sold separately.



#### ■ In severe temperature environments

The operating temperature range extends from –10°C (14°F) to 50°C (122°F). Even under battery operation, measurements can be performed from 0 °C (32°F) to 40°C (104°F) (0°C (32°F) to 50°C (122°F) when using LAN communication).

Fits in tight spaces



#### Magnetic voltage adapters for hard-to-clip terminals

Magnetic voltage adapters convertible with the Voltage Cords L9438-53 let you accurately detect voltage when the circuit terminals are too shallow for alligator clips to latch on.


\* Magnetic Adapter 9804 option sold separately.



Generally compatible with M6 pan screws


#### **Loaded with More Useful Functions**

Simultaneous Measurements Simultaneously measures three single-phase 2-wire circuits in the same system.



Pulse Input The pulse input function can be used to record power data and production volume counts simultaneously. The power data and pulse volume (production volume) information are useful for unit cost production management.





Leakage Current Measurement

#### As a 3-channel Leakage Current Logger

With the optional leakage current clamp on sensors, turn the instrument into a 3-channel leakage current logger to help identify trouble spots.

Options Leak Clamp on Sensor
9675 9657



Load Load Load Power Source

Ideal for quick investigation of intermittent leakage by continuous calculation processing every 200 ms. (Select to save the average, maximum and/or minimum at every interval.)



#### ■ Demand/Time Series Graph Displays

This function will be supported from version 2.00.

Demand graphs at specified times and power time series graphs can be displayed on the color LCD. Observing on-site power fluctuations is useful for confirming energy saving and related effects.




#### Remote Monitor

#### **HTTP Server Function**

Use a LAN cable to connect the PW3360-20 to a personal computer for real-time remote monitoring and measurement display in a web browser.



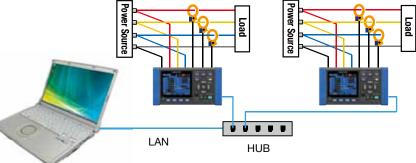

Files recorded in the PW3360-20 internal memory or SD card are accessible by LAN or USB connection, and are downloadable using the free **PW3360 Setup and Download Software**.



#### Power Logger Viewer SF1001 (option, sold separately)


Data saved to an SD card or internal memory can be loaded into a PC for expanded display, aggregation and analysis.

On the same time axis, view measured power consumption and equipment operating status at specific intervals, along with equipment characteristics and management details.


# Simultaneously measure and record separate loads using three PW3360-20s Air Conditioner A Air Conditioner B Air Conditioner C Power Source Air Conditioner C

#### **Stacked Graph Display Example**

Use the [Stacked Display] to confirm at a glance comparative power consumption at multiple locations simultaneously.

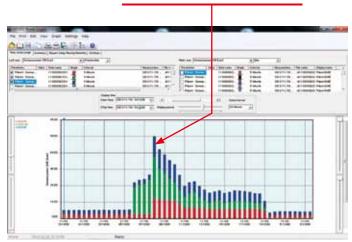


#### Freeware for Model PW3360-20 (free download from Hioki's website)

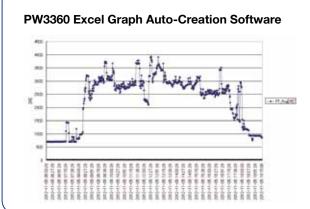

Install the PW3360 Excel Graph Auto-Creation Software to create graphs in Excel automatically using recorded measurement data.

#### PW3360 Setup and Download Software .....

Use with a LAN or USB connection to download data recorded in the PW3360-20's internal memory or SD Card to a PC, and to change instrument settings from the PC.



#### ■ PW3360-20 Specifications (product guaranteed for one year)


Input specificat	tions					
Measurement line type	Single-phase 2-wire, single-phase 3-wire, three-phase 3-wire, three-phase 4-wire					
Measurement line Frequency	50/ 60 Hz					
Number of input channels	Voltage: 3 channels U1 to U3 Current: 3 channels I1 to I3					
Voltage range	600 V AC (single range)					
g g.	Total display area: 5V to 1000 V (less than 5 V displays as 0 V)					
	Effective measurement range: 90 V to 780 V, peak: ±1400V					
	[OVER] indicates over-range warning					
Current ranges	Load current					
, and the second	CLAMP ON SENSOR 9694 : 500m/1/5/10/50 A					
	CLAMP ON SENSOR 9695-02 : 500m/1/5/10/50 A					
	CLAMP ON SENSOR 9660 : 5/10/50/100 A					
	CLAMP ON SENSOR 9695-03 : 5/10/50/100 A					
	CLAMP ON SENSOR 9661 : 5/10/50/100/500 A					
	CLAMP ON SENSOR 9669 : 100/200/1k A					
	FLEXIBLE CLAMP ON SENSOR CT9667 : 500/5k A					
	Leakage current					
	LEAK CLAMP ON SENSOR 9657-10 : 50m/100m/500m/1/5 A					
	LEAK CLAMP ON SENSOR 9675 : 50m/100m/500m/1/5 A					
	Total display range: Within 0.4 to 130% of the range					
	(zero is suppressed for less than 0.4%)					
	Effective measurement range: Within 5 to 110% of the range peak: ±400% of range, however, maximum range is 200%.					
	[OVER] indicates over-range warning					
Power ranges	300.00 W to 9.0000 MW Depends on voltage/current combination and measured line type (see Measurement Range Configuration Tables)					
	Total display range: Within 0 to 130% of the range					
	("0W" display indicates zero rms voltage and/or current)					
	Effective measurement area: Within 5 to 110% of the range					
VT ratio settings	Any (0.01 to 9999.99) Selections (1/60/100/200/300/600/700/1000/2000/2500/5000)					
CT ratio settings	Any (0.01 to 9999.99) Selections (1/40/60/80/120/160/200/240/300/400/600/800/1200)					
Input methods	Voltage: Insolated inputs (except between U1, U2, U3 and N) Current: Isolated input using a clamp-on sensor					
Input resistance	Voltage input part: $3 \text{ M}\Omega \pm 20\% (50/60 \text{ Hz})$					
Maximum rated voltage						
between terminals	Current input section: 1.7 VAC, 2.4 Vpeak					
Maximum rated voltage to earth	Voltage input section: 600V Measurement Category III 300V Measurement Category IV					
	Current input section: Depends on clamp sensor in use.					

Conoral anasis	fications				
General speci					
Display device	3.5 inch TFT color LCD (320 × 240 pixel)				
	Japanese, English (supported from version 1.50), Chinese (Simplified, supported from version 2.00)				
	Backlight auto-off function (after 2 minutes)				
Operating environment	Indoors, Pollution degree 2, altitude up to 2000 m (6562-ft.)				
Operating	-10°C to 50°C (14°F to 122°F), 80% RH or less				
temperature and	During LAN communication: 0°C to 50°C (32°F to 122°F), 80% RH or less				
humidity	During battery operation: 0°C to 40°C (32°F to 104°F), 80% RH or less				
(no condensation)	During battery charging: 10°C to 40°C (50°F to 104°F), 80% RH or less				
Storage	-20°C to 60°C (-4°F to 140°F), 80% RH or less				
temperature and humidity	However, the battery's storage temperature range is -20°C to				
(no condensation)	30°C (-4°F to 86°F), 80% RH or less				
,	4.29 kVrms AC (1 mA sense current) between voltage input				
Dielectric strength	terminals and external terminals, 50/ 60 Hz for 60 sec.				
Applicable standards	Safety: EN61010, EMC: EN61326, EN61000-3-2, EN61000-3-3				
	•Z1006 AC Adapter (12 V, 1.25 A), Rated supply voltage 100 VAC				
Power supply	to 240 VAC, Rated power supply frequency 50/60 Hz				
	•Model 9459 Battery Pack (Ni-MH DC7.2 V 2700 mAh)				
Charge function	Charges the battery regardless of whether the instrument is on or off.				
	Charge time: Max. 6 hr. 10 min. (reference value at 23°C)				
Maximum rated	•When the Z1006 AC Adapter is used: 40 VA (including AC adapter), 13 VA (PW3360-20 instrument only)				
power	•When the 9459 Battery Pack is used: 3 VA				
Continuous	·				
battery	Approx. 8 hr. (Continuous, backlight off)				
operation time	(when using the battery pack)				
Backup battery life	Clock and settings (Lithium battery), Approx. 10 years @23°C (@73.4°F)				
Dimensions	Approx. 180W(7.09") × 100H(3.94") × 48D (1.89") mm (without PW9002)				
DITTELISIONS	Approx. 180W(7.09") × 100H(3.94") × 68D (2.68") mm (with PW9002)				
Mass	Approx. 550g (19.4 oz) (without PW9002), Approx. 830g (29.3 oz) (with PW9002)				
	Voltage Cord L9438-53(1 set), AC Adapter Z1006 (1),				
Accessories	USB cable(1), instruction manual (1), measurement guide (1),				
	color spiral tubes (1 set): red, yellow, blue/two each, for color-coding clamp				
	sensors, spiral tubes for grouping clamp sensor cords (5)				

Measurement s	ř
Connection	Single-phase 2-wire (1P2W, 1P2W × 2 circuits, 1P2W × 3 circuits
	Single-phase 3-wire (1P3W, 1P3W+I, 1P3W1U, 1P3W1U+I)
	Three-phase 3-wire (3P3W2M, 3P3W2M+I, 3P3W3M)
Cimultanagua	Three-phase 4-wire (3P4W), Current only: 1 to 3 channels
Simultaneous power/current	1P3W+I: 1 power circuit and 1 current channel
measurement modes	3P3W2M+I: 1 power circuit and 1 current channel
Measurement	Voltage RMS, current RMS, voltage fundamental wave value
items	current fundamental wave value, voltage fundamental wave phase
	angle, current fundamental wave phase angle, frequency (U1 voltage waveform peak (absolute value), current waveform pea
	(absolute value), active power, reactive power (with lag/lea
	display), apparent power, power factor (with lag/lead display) of
	displacement power factor (with lag/lead display), active energ
	(consumption, regeneration), reactive energy (consumption regeneration), electricity rate display (by means of planned future
	function update), active power demand quantity (consumption
	regeneration), reactive power demand quantity (lag, lead), activ
	power demand value (consumption, regeneration), reactive power
0 1 1 1	demand value (lag, lead), power factor demand, pulse input
Calculation selection	Power factor, reactive and apparent power: rms calculation fundamental wave calculation
Measurement	Voltage: ±0.3% rdg. ±0.1% f.s.
accuracy	Current: ±0.3% rdg. ±0.1% f.s. + clamp sensor accuracy
(50/ 60Hz,	Active power: ±0.3% rdg. ±0.1% f.s. +clamp sensor accuracy
power factor = 1)	Clamp-On Sensor 9661 accuracy: ±0.3% rdg. ±0.01% f.s.
	(Accuracy depends on clamp sensor. See page 6 for the accuracy of
	each model, and page 7 for combined accuracy of Model PW3360-2
	and each clamp sensor.)  Approx. 0.5 sec (except when accessing SD card or internal memory
Display update rate	or during LAN/USB communication)
Measurement	Digital sampling and zero cross synchronization calculation metho
method	Sampling: 10.24 kHz (2048 points)  Calculation processing
	50 Hz: Continuous, gapless measurement at 10 cycles
	60 Hz: Continuous, gapless measurement at 12 cycles
A/D converter resolution	16bit
Recording sp	
Recording sponsor description  Recording sponsor description  Save destination  Save interval time	ecifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes
Recording sponsor Save destination Save interval time	ecifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree
Recording spo	ecifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum
Recording sponsor Save destination Save interval time	ecifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min
Recording sponsor Save destination Save interval time	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe  interval.) The minimum interval time for saving screen copies is 5 min  If the setting is less than 5 min., screen copies will be saved every 5 min
Recording sponsor Save destination Save interval time	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe  interval.) The minimum interval time for saving screen copies is 5 min  If the setting is less than 5 min., screen copies will be saved every 5 min
Recording sp Save destination Save interval time Save items	ecifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min, screen copies will be saved every 5 min Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time
Recording sp Save destination Save interval time Save items	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe  interval.) The minimum interval time for saving screen copies is 5 mi  If the setting is less than 5 min., screen copies will be saved every 5 min  Waveform save: Stores binary waveform data (with shortes)  interval 1 minute) Supported from version 2.00
Recording sp. Save destination Save interval time Save items  Recording start methods Recording stop methods	Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimun  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi  If the setting is less than 5 min., screen copies will be saved every 5 min  Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time
Recording sp Save destination Save interval time Save items	Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimun  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi  If the setting is less than 5 min., screen copies will be saved every 5 min  Waveform save: Stores binary waveform data (with shorter interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time  Manual, or at specified time (up to one year)
Recording sp Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimun  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mil  If the setting is less than 5 min., screen copies will be saved every 5 min  Waveform save: Stores binary waveform data (with shortes interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time  Manual, or at specified time (up to one year)
Recording sp Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input Input specifications	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input Input specifications  Measurement range	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input Input specifications	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min If the setting is less than 5 min., screen copies will be saved every 5 min Waveform save: Stores binary waveform data (with shortes interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo) 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input Input specifications  Measurement range	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min, screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input Input specifications  Measurement range	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods  Pulse input Input specifications  Measurement range	Colfications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimun  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix  interval.) The minimum interval time for saving screen copies is 5 mi  If the setting is less than 5 min., screen copies will be saved every 5 mi  Waveform save: Stores binary waveform data (with shorter  interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time  Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open)  Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H  Maximum rated input between terminals: 45 V DC  Maximum rated input to ground: not isolated (GDI is equipment commo  0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2  ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  µs Hi and Lo pulse width  Displays product of pulse count and scaling factor setting
Recording sponsave destination Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width
Recording sponsor description Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications Measurement range Filter  Scaling  Pulse output	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min, screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width  Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00
Recording sponsor description Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications Measurement range Filter  Scaling  Pulse output	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min, screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption
Recording sponsave destination Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications Measurement range Filter  Scaling  Pulse output Function	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min, screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption
Recording sponsave destination Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications Measurement range Filter  Scaling  Pulse output Function	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  µs Hi and Lo pulse width Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption
Recording sponsave destination Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications Measurement range Filter  Scaling  Pulse output Function	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min If the setting is less than 5 min., screen copies will be saved every 5 min Waveform save: Stores binary waveform data (with shorter interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width  Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/18Wh/106Wh/100kWh/100kWh
Recording sponsor description Save interval time Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width  Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/100Wh/1kWh/10kWh/100kWh/100kWh (Default: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)
Recording sponsor save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorter interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width  Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/1kWh/10kWh/10kWh/100kWh/100kWh (Default: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low
Recording sponsor save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal  External interfa	SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimun Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10 us Hi and Lo pulse width  Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/1kWh/10kWh/10okWh/100kWh/100kWh/100realt: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low  Ces Specifications
Recording sponsor save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal  External interfa	Coifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min  If the setting is less than 5 min., screen copies will be saved every 5 min  Waveform save: Stores binary waveform data (with shortes interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time  Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open)  Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H  Maximum rated input to ground: not isolated (GND is equipment commo  0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2  ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  ms Hi and Lo pulse width  Displays product of pulse count and scaling factor setting  Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/1kWh/10kWh/10kWh/100kWh/100kWh  (Default: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low  Ces Specifications  Settings data, measurement data, screen data
Recording spo Save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal  External interface	Coifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min If the setting is less than 5 min., screen copies will be saved every 5 min Waveform save: Stores binary waveform data (with shortes interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  *No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width  Displays product of pulse count and scaling factor setting setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/10Wh/10kWh/10kWh/10kWh/100kWh/100kWh (Default: 1 kWh) approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low  Ces Specifications  Settings data, measurement data, screen data  Waveform data (support planned from version 2.00)
Recording sponsor save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal  External interfa	Coifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum  Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 min  If the setting is less than 5 min., screen copies will be saved every 5 min  Waveform save: Stores binary waveform data (with shortes interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time  Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open)  Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H  Maximum rated input to ground: not isolated (GND is equipment commo  0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2  ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  ms Hi and Lo pulse width  Displays product of pulse count and scaling factor setting  Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/1kWh/10kWh/10kWh/100kWh/100kWh  (Default: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low  Ces Specifications  Settings data, measurement data, screen data
Recording spo Save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal  External interface	Cifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree  Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fixe interval.) The minimum interval time for saving screen copies is 5 mi  If the setting is less than 5 min., screen copies will be saved every 5 mi If the setting is less than 5 min., screen copies will be saved every 5 mi Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time  Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open)  Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC  Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2  ms Hi and Lo pulse width  Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  µs Hi and Lo pulse width  Displays product of pulse count and scaling factor setting  Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/1Wh/10Wh/100Wh/1kWh/10kWh/10kWh/100kWh/1000kWh (Default: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low  Ces Specifications  Settings data, measurement data, screen data  Waveform data (support planned from version 2.00)  10BASE-T/100BASE-TX IEEE802.3 Compliance  - HTTP server function  - Download settings and data by communication application program
Recording spo Save destination Save interval time Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate Pulse width Output signal  External interface	Cifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min, screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  µs Hi and Lo pulse width Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption OFF/IWh/10Wh/100Wh/1kWh/10kWh/100kWh/100kWh (Default: 1 kWh) approx. 100 ms Open-collector 30 V, 5 mA max (photocoupler isolated) Active Low  Ces Specifications  Settings data, measurement data, screen data Waveform data (support planned from version 2.00)  10BASE-T/100BASE-TX IEEE802.3 Compliance - HTTP server function - Download settings and data by communication application prograu USB Ver 2.0, Windows 7 (32/64bit) / Vista (32bit) /XP
Recording spo Save destination Save interval time Save items  Recording start methods Recording stop methods Pulse input Input specifications  Measurement range Filter  Scaling  Pulse output Function  Pulse rate  Pulse width Output signal  External interfa SD card Interface  LAN interface	Cifications  SD Card, internal memory (capacity: approx. 320 KB)  1/2/5/10/15/30 seconds, 1/2/5/10/15/20/30/60 minutes  * Available storage time is displayed on PW3360-20's setting scree Measurement save: Average only / all (average, maximum, minimum Screen copy: ON/OFF (Saves the displayed screen as a BMP at a fix interval.) The minimum interval time for saving screen copies is 5 mi If the setting is less than 5 min, screen copies will be saved every 5 mir Waveform save: Stores binary waveform data (with shorte: interval 1 minute) Supported from version 2.00  Interval time, manual, or at specified time Manual, or at specified time (up to one year)  No-voltage contact input (counts when shorted terminals open) Voltage input (Hi: 2 V to 45 V, Lo: 0 V to 0.5 V, counts at Lo to H Maximum rated input between terminals: 45 V DC Maximum rated input to ground: not isolated (GND is equipment commo 0 to 9999 (maximum pulse count per save interval)  Filter On (for mechanical contacts) 25 Hz or less, and at least 2 ms Hi and Lo pulse width Filter Off (for solid-state contacts) 5 kHz or less, and at least 10  µs Hi and Lo pulse width  Displays product of pulse count and scaling factor setting Setting ranges: 0.001 to 1.000, and 1.000 to 100.00  Output pulse rate is proportional to active power consumption  OFF/IWh/10Wh/100Wh/1kWh/10kWh/100kWh/100kWh (Default: 1 kWh)  approx. 100 ms  Open-collector 30 V, 5 mA max (photocoupler isolated)  Active Low  Ces Specifications  Settings data, measurement data, screen data  Waveform data (support planned from version 2.00)  10BASE-T/100BASE-TX IEEE802.3 Compliance  - HTTP server function  - Download settings and data by communication application program

#### ■ POWER LOGGER VIEWER SF1001 Specifications

General Specifications			
Read-compatible model	PW3360-20		
Supported	Windows 7 SP1 or later (32/64bit)		
computer operating	Windows Vista SP2 or later (32bit)		
systems	Windows XP SP3 or later (32bit)		



<b>Functions Speci</b>	fications			
Time series graph display function	Display items: Voltage, current, active power, reactive power, apparent power, power factor, frequency, integrated active power, integrated reactive power, demand volume, demand value, voltage disequilibrium factor, pulse  *Measurement values can be displayed by the cursor			
	<b>Stacked bar graph display</b> : Up to 16 types of data series can be displayed in an overlay graph			
Summary display function	Displayed items are the same as for Time Series Graph Display - Display and totalize monthly/weekly/daily reports for specified period - Calculate load factor and demand factor for daily/weekly/monthly reports, and displays results - Hourly totalization (up to four segments)			
Copy function	Captures any display image to the clipboard			
	Preview and print content shown on the time series graph, report, and settings displays.			
Print function	Comment entry (Text comments can be entered in any printout)			
	Printing support: Any color or monochrome printing supported by the operating system			
Report printing	Print (static) contents over a specific time period			

#### **■ CLAMP SENSOR Specifications**

#### **CLAMP ON SENSOR**

		9694	9660	9661	9669	9695-02	9695-03
Appearance		Q CE	Q CE	Q\ (e	Q <sub>C</sub>	CE	€ C€
,		Cord length: 3 m	Connect with the 9695-02/-03,	219			
		(9.84ft)	(9.84ft)	(9.84ft)	(9.84ft)	Output BNC terminal	Cord length: 3 m (9.84ft)
Measu	rable conductor diameter	φ15mm (0.59")	φ15mm (0.59")	ф46mm (0.81")	φ55mm (2.17"), 80 (3.15")×20 (0.79")mm	φ15mm (0.59")	φ15mm (0.59")
Prima	ry current rating	5A AC	100A AC	500A AC	1000A AC	50A AC	100A AC
	Amplitude (45 to 66 Hz)	±0.3% rdg.	±0.3% rdg.	±0.3% rdg.	±1.0% rdg.	±0.3% rdg.	±0.3% rdg.
Accuracy	Amplitude (45 to 66 Hz)	±0.02% f.s.	±0.02% f.s.	±0.01% f.s.	±0.01% f.s.	±0.02% f.s.	±0.02% f.s.
	Phase (45 Hz to 5 kHz)	Within ±2°	Within ±1°	Within ±0.5°	Within ±1°	Within ±2°	Within ±1°
40	ncy characteristic DHz to 5kHz on from accuracy)		Within ±1.0%		Within ±2.0%	Within	±1.0%
	xternal magnetic field netic field of 400 A/ m AC)	Е	Equivalent to 0.1 A or	less	Equivalent to 1 A or less	Equivalent to	0.1 A or less
Effect of	conductor position		Within ±0.5%		Within ±1.5% Within ±0.5%		±0.5%
Maximum rated voltage to earth		CAT III 300Vrms	CAT III 300Vrms	CAT III 600Vrms	S CAT III 600Vrms CAT III 3		00Vrms
Maximur	m input (45 to 66Hz)	50 A continuous	130 A continuous	550 A continuous	1000 A continuous	60 A continuous	130 A continuous
	imensions	46W (1.81") × 135H (5.31")	46W (1.81") × 135H (5.31")	77W (3.03") × 151H (5.94")	99.5W (3.92") × 188H (7.40")	50.5W(2.28")	× 58H(2.28")
		× 21D (0.83") mm	× 21D (0.83") mm	×42D(1.65") mm	×42D (1.65") mm	×18.7D(0	.74") mm
Mass		230g (8.1 oz)	230g (8.1 oz)	380g (13.4 oz)	590g (20.8 oz)	50g (1	.8 oz)

#### **FLEXIBLE CLAMP ON SENSOR**

#### CLAMP ON LEAK SENSOR (Leakage Current Measurement Only)

<b>FLEXIBLE</b>	CLAWIF ON	OLINOON	
		CT9667	
Appearance		Cord length: Sensor - circuit: 2 m (6.56ft) Circuit - connector: 1 m (3.28ft)	
Measurable co	nductor diameter	ф254mm	
Primary co	urrent rating	500A AC/5,000A AC	
Accuracy	Amplitude	±2.0% rdg. ±0.3% f.s.	
(45 to 66Hz)	Phase	Within ±1°	
10Hz t	characteristic to 20kHz rom accuracy)	Within ±3 dB	
Effect of extern	nal magnetic field field of 400 A/ m AC)	1.5% / f.s. or less.	
Effect of con	ductor position	Within ±3.0%	
Maximum rated	d voltage to earth	CAT III 1000Vrms, CAT IV 600Vrms	
Maximum input (45 to 66Hz)		10000 A continuous	
Dimensions		Circuit box: 35W (1.38") × 120H (4.74") × 34D (1.34") mm	
M	ass	470g (16.6 oz.) (Sensor + Circuit Box, w/battery)	
Power supply		LR06 alkaline battery × 2 (continuous operation max. 7 days) or AC ADAPTER 9445-02/9445-03 (optional)	

CLAMP ON LEAK SENSOR (Leakage Current Measurement Only)						
		9657-10	9675			
Appearance		Insulated conductor (€	Insulated conductor			
		(9.84ft)	(9.84ft)			
Measurable	e conductor diameter	φ40mm (1.57")	φ30mm (1.18")			
Primar	y current rating	10A AC*	10A AC*			
Accuracy	Amplitude (45 to 66 Hz)	±1.0% rdg. ±0.05% f.s.	±1.0% rdg. ±0.005% f.s.			
	Phase angle (@50 or 60 Hz)	Within ±3°	Within ±5°			
40	cy characteristic Hz to 5kHz n from accuracy)	Within ±5%	Within ±5%			
	ternal magnetic field etic field of 400 A/ m AC)	7.5 mA max.	7.5 mA max.			
Effect of o	conductor position	Within ±0.1%	Within ±0.1%			
Maximum r	ated voltage to earth	CAT III 300Vrms	CAT III 300Vrms			
Maximum input (45 to 66Hz)		30 A continuous	10 A continuous			
Di	mensions	74W(2.91") × 145H(5.71")	60W(2.36") × 112.5H(4.43")			
		× 42D(1.65")	× 23.6D(0.95")			
	Mass	380g (13.4 oz)	160g (5.6 oz)			
	Notes	Not used for power measurements				

<sup>\*</sup> Maximum AC measurement range with PW3360-20 is 5A.

#### ■ Measurement Range Configurations

	Current	CLAMP ON SENSOR 9694 (CAT III 300V) *1				
		CLAMP ON SENSOR 9695-02 (CAT III 300V)				
Voltage	Connection	500.00 mA	1.0000 A	5.0000 A	10.000 A	50.000 A
	1P2W	300.00 W	600.00 W	3.0000 kW	6.0000 kW	30.000 kW
	1P3W	600.00 W	1.2000 kW	6.0000 kW	12.000 kW	60.000 kW
600.00 V	1P3W1U					
600.00 V	3P3W2M					
	3P3W3M					
	3P4W	900.00 W	1.8000 kW	9.0000 kW	18.000 kW	90.000 kW

<sup>\*1.</sup> For the 9694 sensor, the range of guaranteed accuracy is from 500 mA to 5 A, and for the 9695-02, from 500 mA to 50 A.

	Current	CLAMP ON S	ENSOR 9660,	9695-03 (CAT	™ 300V) *2		
		(	CLAMP ON SENSOR 9661				
Voltage	Connection	5.0000 A	10.000 A	50.000 A	100.00 A	500.00 A	
	1P2W	3.0000 kW	6.0000 kW	30.000 kW	60.000 kW	300.00 kW	
	1P3W	6.0000 kW 12.0	12.000 kW	60.000 kW	120.00 kW	600.00 kW	
600.00 V	1P3W1U						
600.00 V	3P3W2M						
	3P3W3M						
	3P4W	9.0000 kW	18.000 kW	90.000 kW	180.00 kW	900.00 kW	

<sup>\*2.</sup> For the 9660 and 9695-03 sensors, the range of guaranteed accuracy is from 5 A to 100 A, and for the 9661, from 5 A to 500 A.

#### Total display range

Voltage is displayed from 5 V to 1000 V, with less than 5 V displayed as 0 V.

Current is displayed from 0.4% to 130% of the selected range, with less than 0.4% displayed as 0 A  $\,$ 

Power is displayed from 0 to 130% of full scale, with 0 W displayed when voltage or current is zero.

The range configurations for apparent power (S) and reactive power (Q) are the same, with units of [VA] and [var], respectively.

When VT and CT ratios are set, the range configuration is the product (VT ratio  $\times$  CT ratio).

#### Effective measurement range

For voltage, 90 to 780 V, with max. 1400 V peak. For current, 5% to 110% of the selected range with peak  $\pm 400\%$  of range, but maximum range is  $\pm 200\%$ . For power, 5% to 110% of the selected range. For frequency, 45 to 66 Hz.

Current		CLAMP ON SENSOR 9669			
Voltage Connection		100.00 A	200.00 A	1.0000 kA	
	1P2W	60.000 kW	120.00 kW	600.00 kW	
	1P3W		240.00 kW	1.2000 MW	
600.00 V	1P3W1U	120.00 kW			
600.00 V	3P3W2M				
	3P3W3M				
	3P4W	180.00 kW	360.00 kW	1.8000 MW	

Current		FLEXIBLE CLAMP ON SENSOR CT9667		
Voltage Connection		500.00 A	5.0000 kA	
	1P2W	300.00 kW	3.0000 MW	
	1P3W	600.00 kW	6.0000 MW	
600.00 V	1P3W1U			
600.00 V	3P3W2M			
	3P3W3M			
	3P4W	900.00 kW	9.0000 MW	

Leak current: CLAMP ON LEAK SENSOR 9657-10, 9675	
Range	50.000 mA/100.00 mA/500.00 mA/1.0000 A/5.0000 A

#### Measurement accuracy

Voltage	±0.3% rdg. ±0.1% f.s.
Current	±0.3% rdg. ±0.1% f.s. + clamp sensor accuracy
Active power	$\pm 0.3\%$ rdg. $\pm 0.1\%$ f.s. + clamp sensor accuracy (power factor = 1)

#### Combined accuracy of PW3360-20 + clamp sensors


Range	9694	9695-02
50.000 A	_	±0.6% rdg. ±0.12% f.s.
10.000 A	_	±0.6% rdg. ±0.2% f.s.
5.0000 A	±0.6% rdg. ±0.12% f.s.	±0.6% rdg. ±0.3% f.s.
1.0000 A	±0.6% rdg. ±0.2% f.s.	±0.6% rdg. ±1.1% f.s.
500.00 mA	±0.6% rdg. ±0.3% f.s.	±0.6% rdg. ±2.1% f.s.

Range	9660, 9695-03	9661
500.00 A	_	±0.6% rdg. ±0.11% f.s.
100.00 A	±0.6% rdg. ±0.12% f.s.	±0.6% rdg. ±0.15% f.s.
50.000 A	±0.6% rdg. ±0.14% f.s.	±0.6% rdg. ±0.2% f.s.
10.000 A	±0.6% rdg. ±0.3% f.s.	±0.6% rdg. ±0.6% f.s.
5.0000 A	±0.6% rdg. ±0.5% f.s.	±0.6% rdg. ±1.1% f.s.

Range	9669
1.0000 kA	±1.3% rdg. ±0.11% f.s.
200.00 A	±1.3% rdg. ±0.15% f.s.
100.00 A	±1.3% rdg. ±0.2% f.s.

Range	CT9667 5.000 kA range	CT9667 500 A range
5.0000 kA	±2.3% rdg. ±0.4% f.s.	_
500.00 A	_	±2.3% rdg. ±0.4% f.s.

#### ■ Current Display and Effective Measurement Ranges (typical)

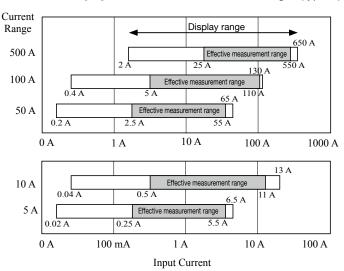

Conditions of guaranteed accuracy	After 30 minute warm-up, with 50/60 Hz sine wave input
Temperature and humidity for guaranteed accuracy	23°C ±5°C (73 ± 9°F), 80%RH or less (applies to all specifications unless otherwise noted)
Display area of guaranteed accuracy	Effective measurement range
Period of guaranteed acuracy	1 year
Real-time clock accuracy	Within ±0.3 sec/day (with power on, within specified operating temperature and humidity ranges)
Temperature characteristic	Within ±0.1% f.s./ °C (except 23 ±5°C)
Effect of common mode voltage	Within $\pm 0.2\%$ f.s. (600 V AC, 50/60 Hz, between voltage input terminal and case)
Effect of external magnetic field	Within ±1.5% f.s. (in a magnetic field of 400 A/m rms AC, 50/60 Hz)
Effect of phase	Phase accuracy ±0.3° equivalent (with 50/60 Hz f.s. input)
Apparent power	±1 dgt. for the calculation obtained from each measurement value
Reactive power	Fundamental waveform calculations ±0.3% rdg. ±0.1% f.s. + clamp-on sensor accuracy (w/power factor = 1)
	Rms calculations From each measurement applied to calculation ±1 dgt.
Energy	Active and reactive power measurement accuracies ±1 dgt.
Power factor	From each measurement applied to calculation ±1 dgt.
Frequency	±0.5% rdg. (with 90 to 780 V sine wave input)
Demand value	Active and reactive power measurement accuracies ±1 dgt.
Demand quantity	Active and reactive power measurement accuracies ±1 dgt.
Pulse input	±1 dgt. for the calculation obtained from each measurement value
Frequency characteristic	At 50/60 Hz fundamental waveform frequency, up to 1 kHz, ±3% rdg. ±0.2% f.s. up to 3kHz, ±10% rdg. ±0.2% f.s. For current and active power, add clamp-on sensor accuracy.

#### **CLAMP ON POWER LOGGER PW3360-20**



#### **Accessories**

**VOLTAGE CORD L9438-53** (1 set), **AC ADAPTER Z1006** (1), USB cable (1), instruction manual (1), measurement guide (1), color spiral tubes (1 set): red, yellow, blue/two each, for color-coding clamp sensors, spiral tubes for grouping clamp sensor cords (5)

Clamp-On Power Logger PW3360-20 by itself does not support current and power measurements. Current and power measurements require clamp-on sensors, sold separately. Also, use only HIOKI-issued SD cards guaranteed to work for saving measurement data, (options, sold separately).

#### AC ADAPTER Z1006

#### **VOLTAGE CORD L9438-53**





#### Options

#### **CLAMP ON SENSOR** (for load current measurement)

CLAMP ON SENSOR 9694 (AC5A)

CLAMP ON SENSOR 9660 (AC100A)

CLAMP ON SENSOR 9661 (AC500A)

CLAMP ON SENSOR 9669 (AC1000A)

FLEXIBLE CLAMP ON SENSOR CT9667 (AC5000A)

CLAMP ON SENSOR 9695-02 (AC50A)

CLAMP ON SENSOR 9695-03 (AC100A)

CONNECTION CORD 9219 (for connection to 9695-02, 9695-03)

When purchasing the 9695-02 and 9695-03, we recommend also purchasing the separately sold 9219 Connection Cord.

#### CLAMP ON LEAK SENSOR (for leakage current measurement)

CLAMP ON LEAK SENSOR 9657-10 CLAMP ON LEAK SENSOR 9675

# CLAMP ON ADAPTER 9290-10 MAX. 1500A AC (continuous: 1000A) Primary side 1000A Primary side 1000A Secondary side 100A Measurable conductor diameter \$\phi\$55 mm (2.17in) Bus bar: \$\bigs 80 mm (3.46in) \times 20 mm (0.79 in) CT ratio: 10:1

#### SD MEMORY CARD 2GB

#### Z4001




Stores up to one year's data when acquired at one minute intervals. Performance cannot be guaranteed on storage media other than Hiokispecified SD card options.

#### **VOLTAGE LINE POWER ADAPTER**

#### PW9003 Rated voltage: 240 V AC

 $(supplies\ power\ from\ measurement\ lines) \quad \ \ \frac{\ \ \, }{Operating\ temperature\ and\ humidity\ range:\ -10\ to\ 50^{\circ}C,\ 80\%\ RH\ or\ less}$ 



#### **BATTERY SET**

Battery Case and Battery Pack Set

PW9002

#### — BATTERY PACK 9459

For purchase as replacement battery pack

#### **CARRYING CASE**

#### C1005



#### **MAGNET ADAPTER**

# 9804-01 Red 9804-02 Black \$\text{\$\text{\$0\$} 11mm (0.43 in)}\$

(generally compatible with M6 pan screws)

Magnetic tip for use with the standard VOLTAGE CORD L9438-53

Red and black adapters sold separately. Purchase the quantity and color appropriate for your application.

(Example: 3P3W-3 adapters, 3P4W-4 adapters)

#### POWER LOGGER VIEWER

#### SF1001



#### LAN CABLE

#### 9642

